


PLAN

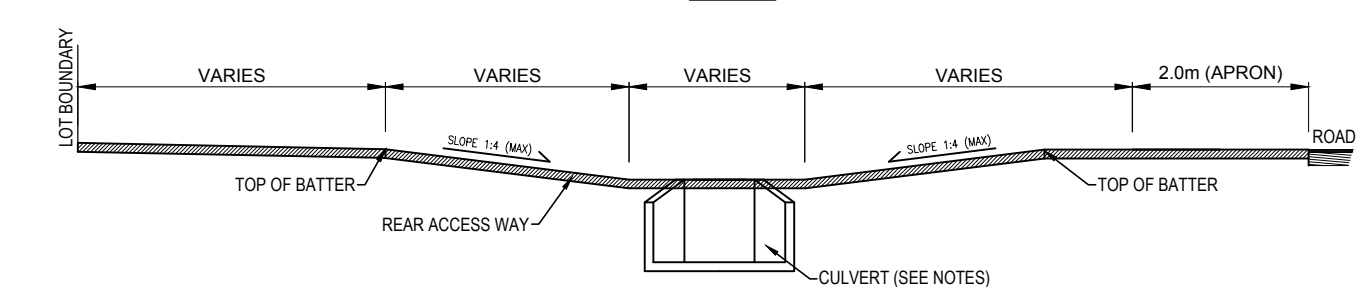

ELEVATION

NOTES

1. COUNCIL STANDARD FOR DAMPIER REAR ACCESS WAY IS 3m WIDE.
2. ALL NEW REAR ACCESS WAY TO HAVE CULVERT AND STONE PITCHING AS APPROVED BY CITY.
3. STONE PITCHING SIZES TO BE AS PER MAIN ROADS WA SPECIFICATION 406
4. FOR REINFORCED CONCRETE PIPES (RCP), REFER TO MAIN ROADS WA STANDARD DRAWINGS
5. FOR REINFORCED BOX CULVERTS (RBC), REFER TO MAIN ROAD WA STANDARD DRAWINGS
6. CONCRETE SLAB TO BE 100mm THICK WITH SL82 MESH REINFORCEMENT PLACED CENTRALLY WITH A WATERPROOF MEMBRANE.
7. GRAVEL ROAD BASE TO BE COMPACTED A MIN. 95% MDD OR EQUIVALENT TO CITY SPECIFICATIONS
8. THE EDGE OF SEAL TO BE SAW-CUT TO GIVE A TRUE AND NEAT EDGE.
9. CONSTRUCTION JOINTS SHALL BE 20mm DEEP AND 5mm WIDE AND FORMED WITH A CUTTING TOOL AT 3m INTERVALS.
10. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 32MPa AT 28 DAYS.
11. THE MAXIMUM GRADE FOR THE FIRST 3m OF VERGE TO BE LESS THAN OR EQUAL TO ± 2%.
12. LENGTH OF OUTLET ROCK PROTECTION, L,
 PIPE DIAMETER (OR BOX HEIGHT) $D = 450\text{mm}$, $L=4 D$
 PIPE DIAMETER (OR BOX HEIGHT) $D > 450\text{mm} \leq 1500\text{mm}$, $L=6 D$
 PIPE DIAMETER (OR BOX HEIGHT) $D > 1500\text{mm} \leq 2500\text{mm}$, $L=8 D$

REAR ACCESS WAY
STANDARD 3m WIDE

DO NOT SCALE TAKE FIGURED DIMENSION ONLY		CITY OF KARRATHA STANDARD DRAWINGS
REV	DATE	
A	21/10/19	ORIGINAL ISSUE
PH		TECHNICAL SERVICES
REVISIONS		

City of Karratha
CITY OF KARRATHA
 STANDARD DRAWINGS

TITLE
DAMPIER REAR ACCESS WAY

STANDARD DRAWING No
KSD-1003